

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 1 of 6

DiamondLife

234 Lott Road, Pittsburgh, PA 15235 USA

The following sample(s) was / were submitted and identified on behalf of the client as:

Sample Description: SLATWALL PX^o PANEL**Composition:** PVC**End Use Application:** WALL PANEL**Test Requested:**

To determine the flame spread index (FSI) and smoke-developed index (SDI) of the sample's surface burning characteristics when it is subjected to the conditions of specified in ASTM E84-12 "Standard Test Method for Surface Burning Characteristics of Building Materials"

Test Results: -- See attached sheet --**Test Period:**

Sample Receiving Date : OCT.30, 2012

Test Performing Date : OCT.30, 2012 TO NOV.16, 2012



Allen Zou
Technical Supervisor

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 2 of 6

I. TEST CONDUCTED

This test was conducted in accordance with ASTM E84-12 Standard Test Method for Surface Burning Characteristics of Building Materials.

II. INTRODUCTION

The method, designated as ASTM E84-12, "Standard Method of Test for Surface Burning Characteristics of Building Materials", is designed to determine the relative surface burning characteristics of materials under specific test conditions. Results are expressed in terms of flame spread index (FSI) and smoke developed index (SDI).

The purpose of this test method is to determine the relative burning behavior of the material by observing the flame spread along the specimen. Flame spread and smoke developed index are reported. However, there is not necessarily a relationship between these two measurements.

III. TEST PROCEDURE

The tunnel is preheated to 150°F, as measured by the floor-embedded thermocouple located 23.25 feet downstream of the burner ports, and allowed to cool to 105°F, as measured by the floor-embedded thermocouple located 13 feet from the burners. At this time the tunnel lid is raised and the test sample is placed along the ledges of the tunnel so as to form a continuous ceiling 24 feet long, 12 inches above the floor. The lid is then lowered into place.

Upon ignition of the gas burners, the flame spread distance is observed and recorded every 15 seconds. Flame spread distance versus time is plotted ignoring any flame front recessions. If the area under the curve (A) is less than or equal to 97.5 min·ft, $FSI = 0.515 \cdot A$; if greater, $FSI = 4900/(195-A)$. Smoke developed is determined by comparing the area under the obscuration curve for the test sample to that of inorganic reinforced cement board and red oak, arbitrarily established as 0 and 100, respectively.

IV. CONDITIONING

Prior to testing, the sample was conditioned,

To a constant weight at a temperature of $73.4 \pm 5^\circ\text{F}$ ($23 \pm 2.8^\circ\text{C}$) and at a relative humidity of $50 \pm 5\%$

To be continued...

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 3 of 6

V. SAMPLE DETAILS

The details of the tested specimen given below have been prepared from information provided by the sponsor of the test. All values quoted are nominal, unless tolerances are given.

Name	SLATWALL PANEL
Color	Grey
Density	5.38kg/m ²

Exposed face:

The front face

MOUNTING METHODS:

The specimen was self-supporting and was placed directly on the inner ledges of the tunnel.

The specimen consisted of 12 pieces of 310mm wide×1110mm long×4.92mm thickness and 2 pieces of 310mm wide×650mm long×4.92mm thickness and all sections jointed end-to-end.

TEST RESULTS

FSI	SDI
20	450

RATING:

The National Fire Protection Association Life Safety Code 101, Chapter 10, Section 10.2.3 "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, ASTM E84, UL 723 "Method of Test of Surface Burning Characteristics of Building Materials".

International Building Code, Chapter 8, Interior Finishes, Section 803 "Wall and Ceiling Finishes", was classified in accordance with ASTM E 84 or UL 723. Such interior finish materials shall be grouped in the following classes in accordance with their flame spread and smoke-developed indexes.

To be continued...

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 4 of 6

The classifications are as follows:

	Class A	Class B	Class C
Flame Spread Index	0-25	26-75	76-200
Smoke-developed Index	0-450	0-450	0-450

Since the tested sample received a Flame Spread Index 20 and a Smoke Developed 450, it would meet the requirement of Class A interior Wall & Ceiling Finish Category.

OBSERVATIONS

Time to ignition (sec)	107
Time to Max. FS (sec)	600
Maximum FS (feet)	8

GRAPHICAL RESULTS:

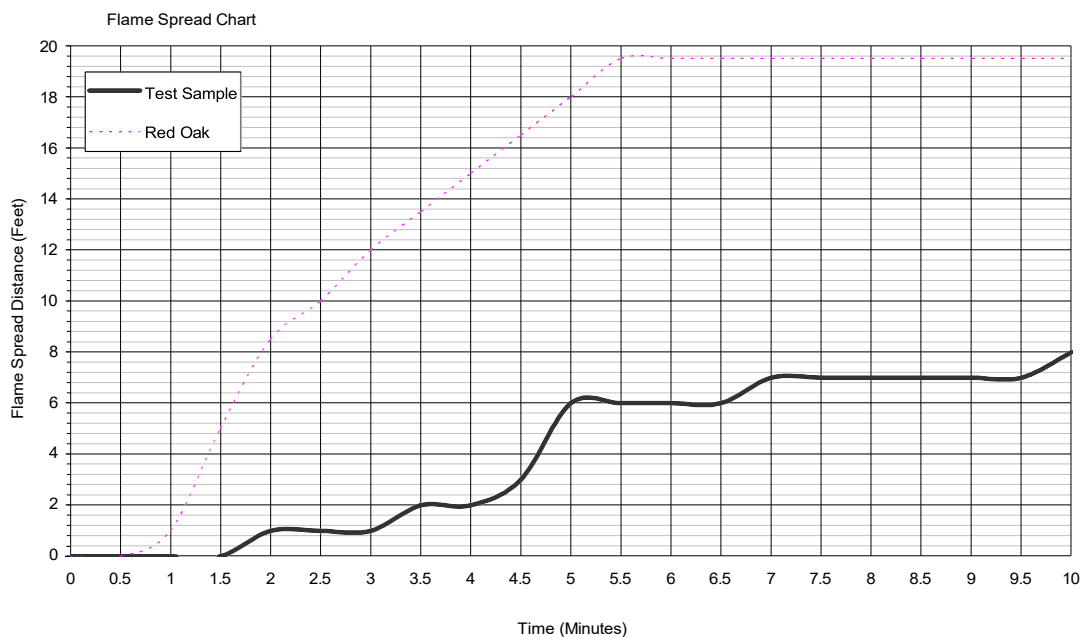


Figure 1 Flame Spread Chart


To be continued....

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 5 of 6

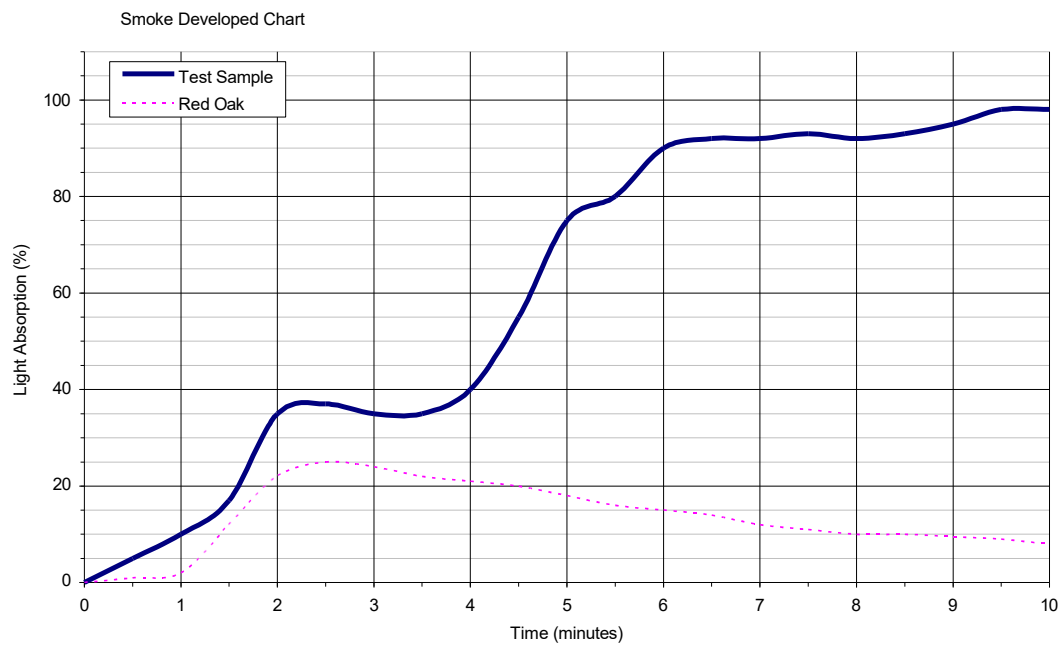**Figure 2 Smoke Developed Chart**

To be continued....

Test Report

No. AJD201206531

Date: NOV.27, 2012

Page 6 of 6

WARNING:

The use of supporting materials on the underside of the test specimen has the ability to lower the flame spread index from those which might be obtained if the specimen could be tested without such support. These test results do not necessarily relate to indices obtained by testing materials without such support.

Testing of materials that melt, drip, or delaminate to such a degree that the continuity of the flame front is destroyed, results in low flame spread indices that do not relate directly to indices obtained by testing materials that remain in place.

The test results relate only to the specimens of the product in the form in which were tested. Small differences in the composition or thickness of the product may significantly affect the performance during the test and may therefore invalidate the test results. Care should be taken to ensure that any product, which is supplied or used, is fully represented by the specimens, which were tested.

The specimen was supplied by the sponsor and SGS-CSTC ANJI Branch was not involved in any selection or sampling procedure.

Photo Appendix:

End of Report